



Controlled by the Casino system

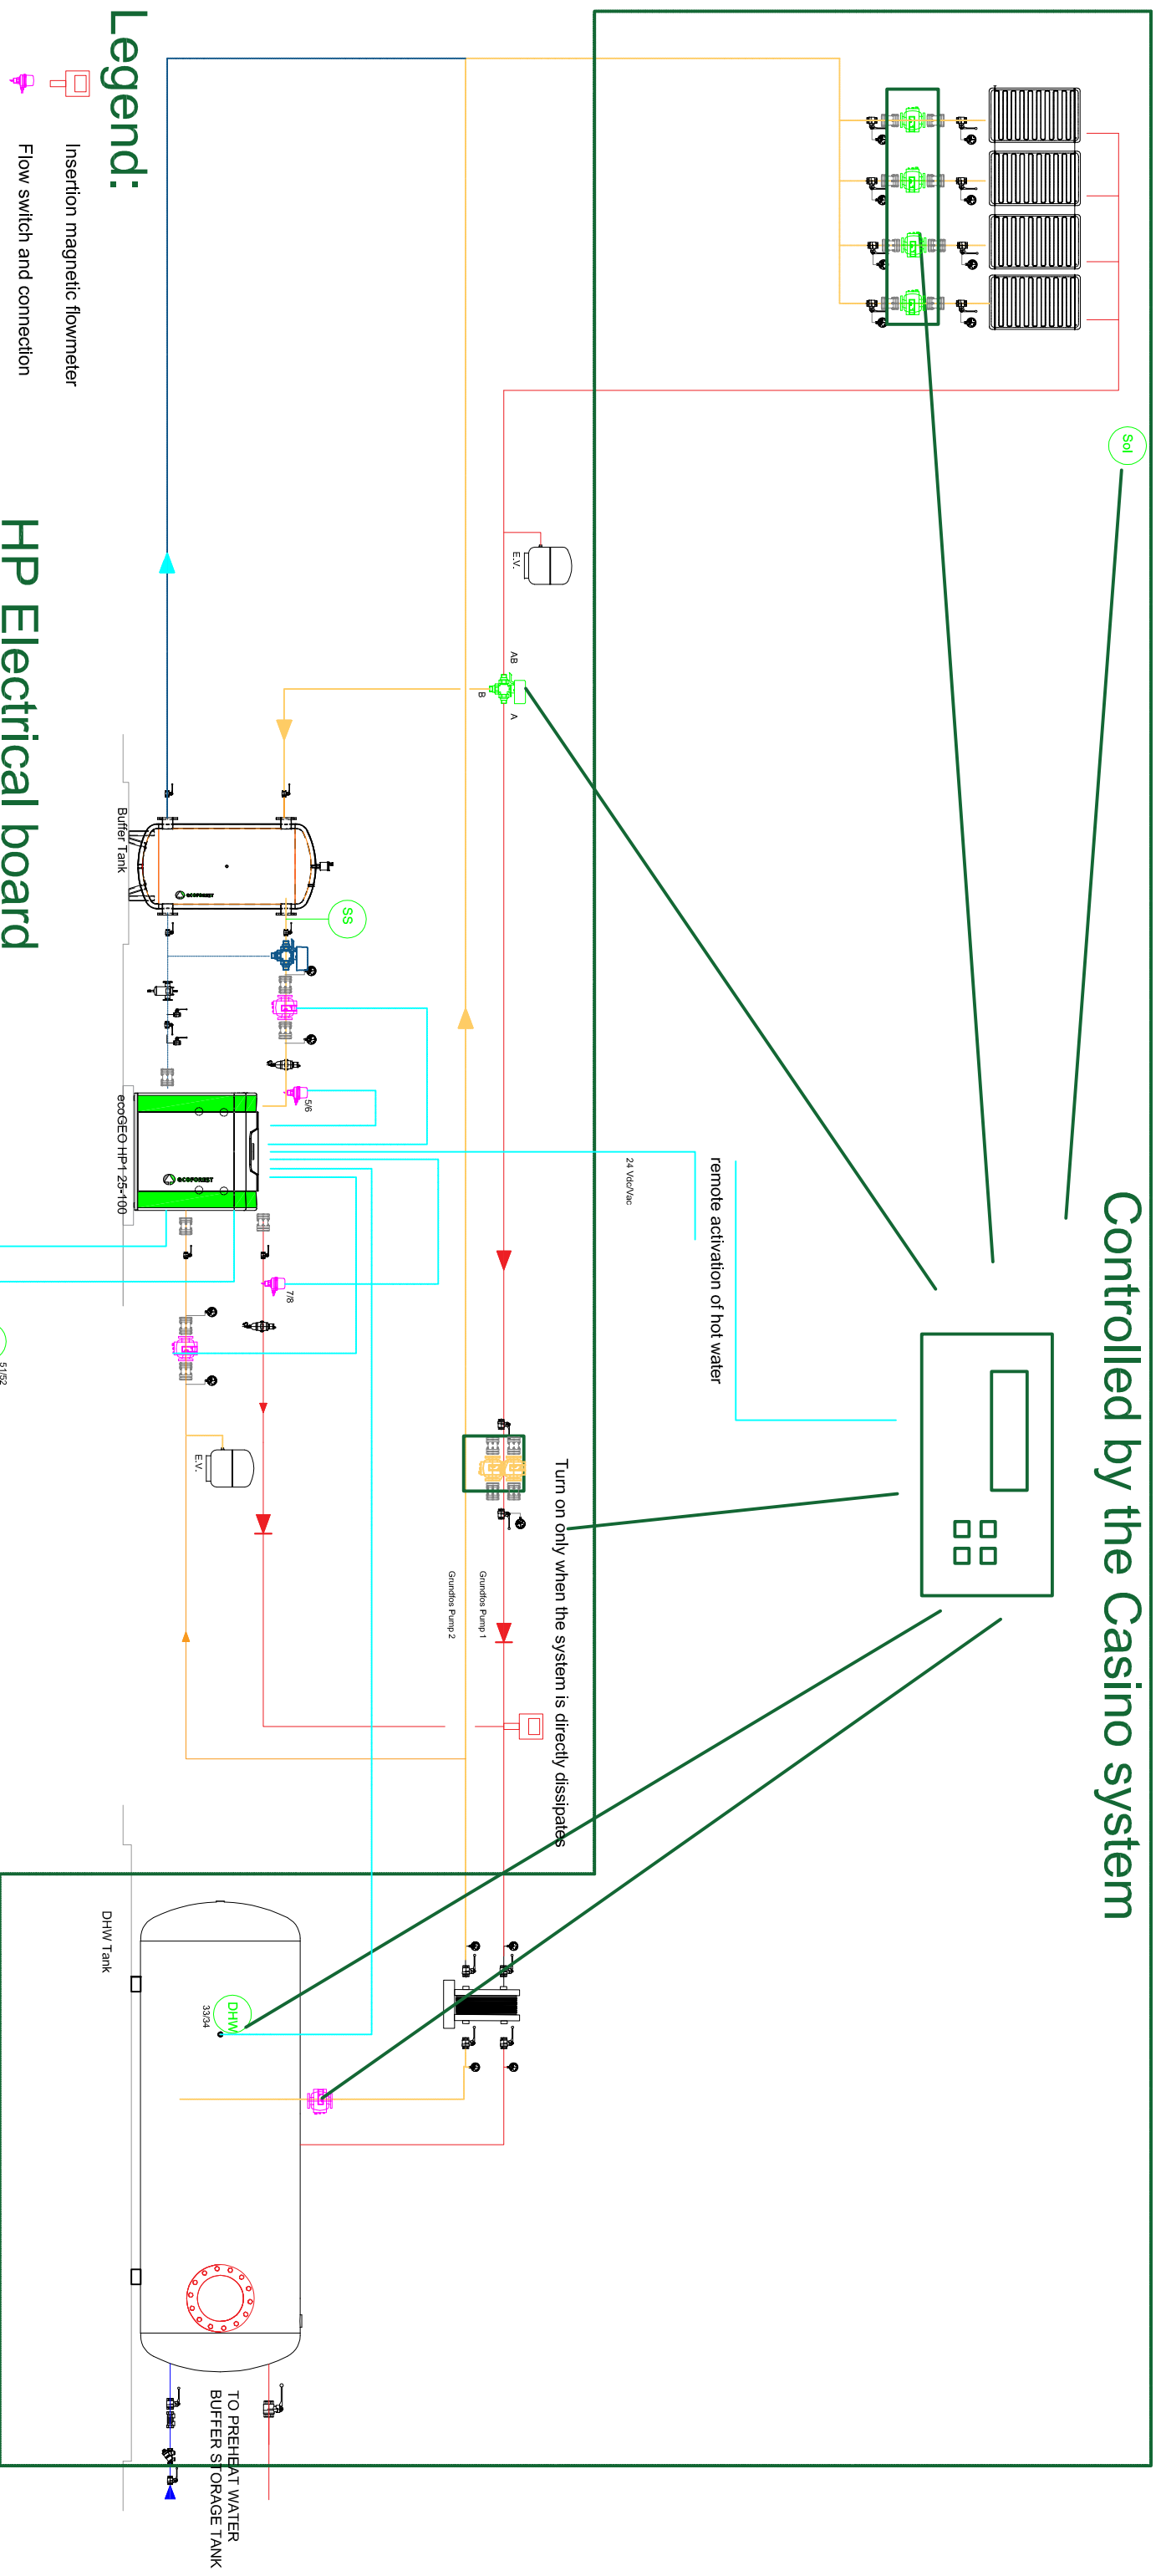

Legend:

- Insertion magnetic flowmeter
- Flow switch and connection
- Wilo TOP S 1,5 X30
- Grundfos
- Wilo Giga
- Expansion Vessel
- Purger
- Filter sludge
- 3 ways valve and connection
- Sensor signal and connection
- 3 ways thermostatic valve
- Check valve
- Outdoor sensor

HP Electrical board

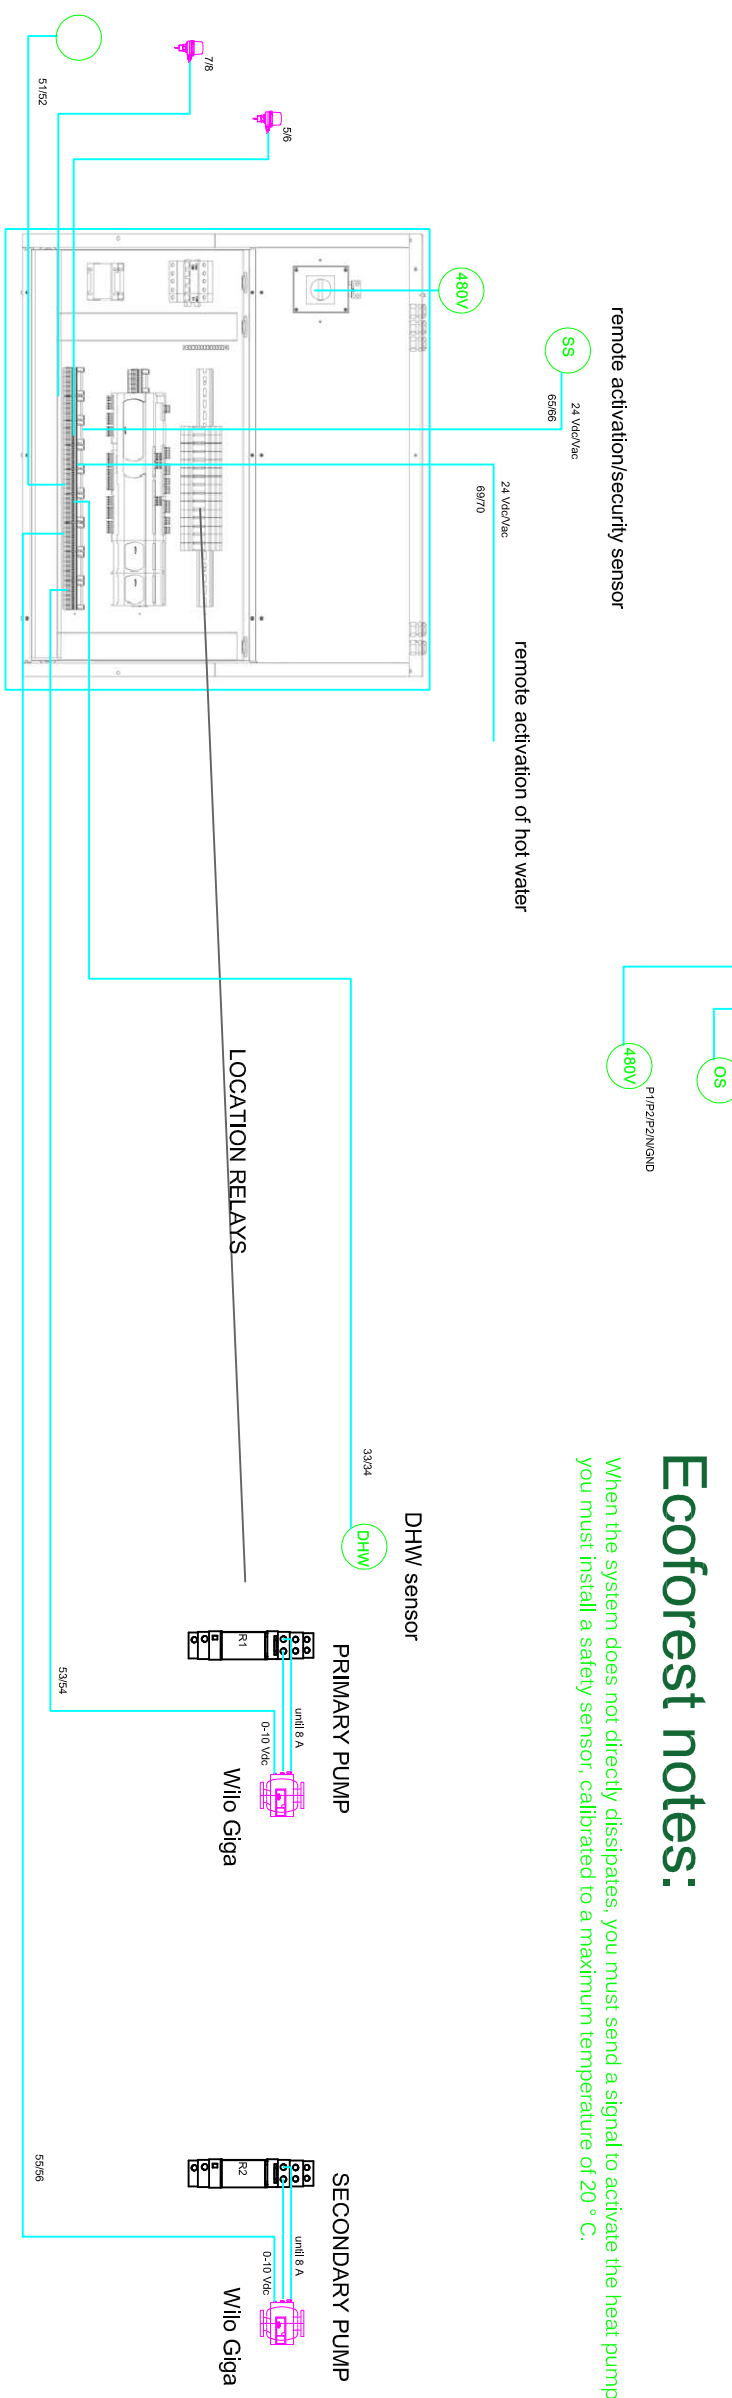

Ecoforest notes:

When the system does not directly dissipates, you must send a signal to activate the heat pump (69 / 70), 24 V you must install a safety sensor, calibrated to a maximum temperature of 20 ° C.